




TOLERANCE - BS 3288 PART 2
 <35mm = 0.7 AND >35mm = 2%
 UNLESS OTHERWISE SPECIFIED

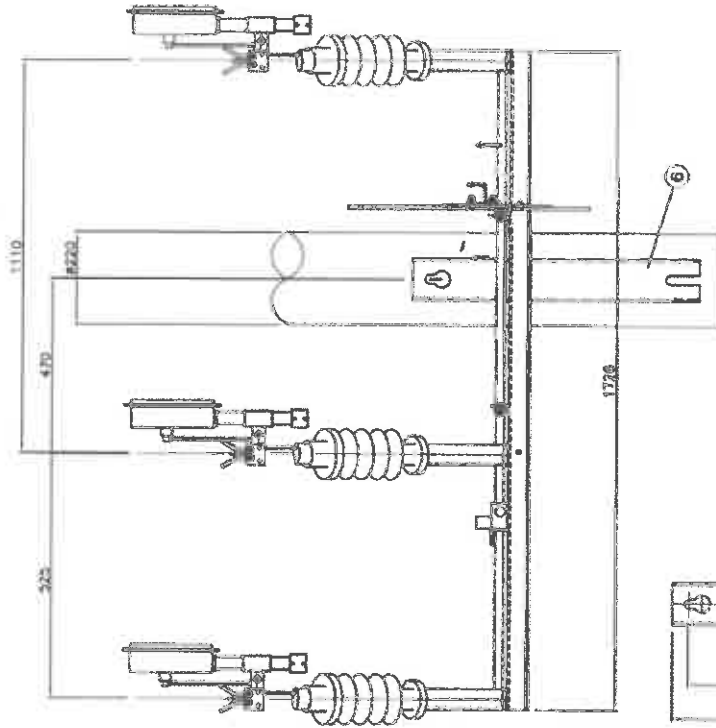


FRONT VIEW HORIZONTAL POSITION
 SINGLE POLE MOUNTING DETAIL



MOUNTING BRACKET DETAIL

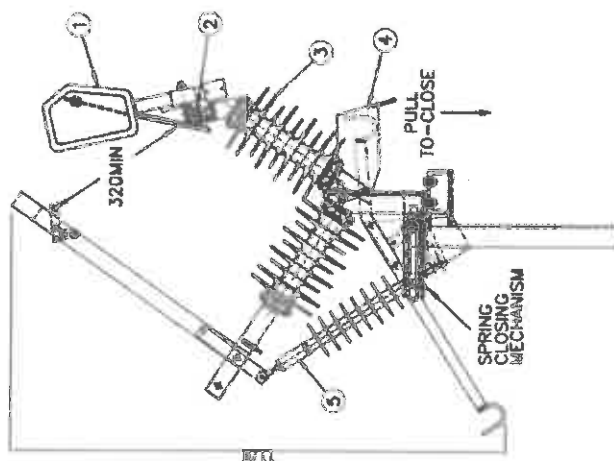

SIDE VIEW
 HORIZONTAL POSITION
 (OPEN)

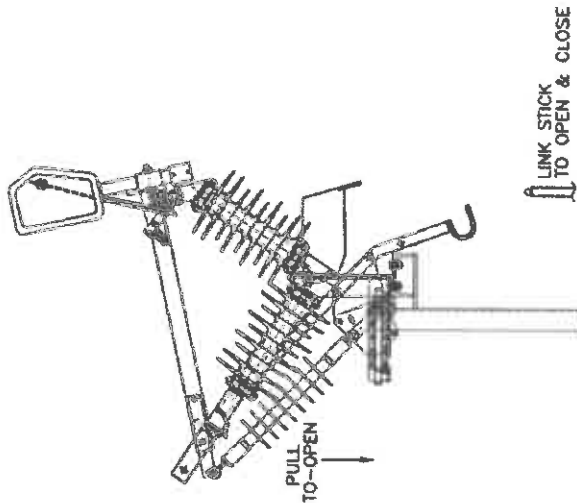

SIDE VIEW
 HORIZONTAL POSITION
 (CLOSED)

PARTS LIST		DESCRIPTION	
6	POLE MOUNTING BRACKET	LG8619	DRG. No.
5	SILICONE DRIVE INSULATOR 765mm CREEPAGE	LG6909	
4	SAFETY FLAG	LG7022	
3	SILICONE RUBBER INSULATORS 815mm CREEPAGE	LG6761	
2	TOP CONTACT ASSEMBLY	SUB00305 LG8382	
1	LOAD BREAK UNIT	ARC00003	
ITEM			

McWade
 Production
 1665 GAUTENG SOUTH AFRICA
 TEL (+27) 11 316-2262 FAX (+27) 11 316-4791

REV	DATE	APP'D	ECR
5	06/15	HJB	COV10
9	10/18	HJB	2295
6	08/15	HJB	1899
7	07/15	HJB	1894
6	07/15	HJB	COV10

DRAWN	HB
DATE	09/08
APPROVED	DN
DATE	09/08
SCALE	N.T.S.
PROJECTION	1 st A.D.

TITLE:	
DISCONNECTOR SINGLE POLE	
Mk5 24kV 400A	
DRG. NO.	REV.
LG8523	9

RATED CURRENT	400A
RATED VOLTAGE	24kV
RATED SHORT CIRC. CURRENT	150kV
TIME	1 SEC
Wt. (kg)	56K

SAP 0175963	(INLAND)
SAP 0186429	(COASTAL)
5LS4KHHSS002000MCWADE	